



PLAN VIEW


MANHOLE RING WITH TAMPERPROOF COVER




OPTIONAL COVER

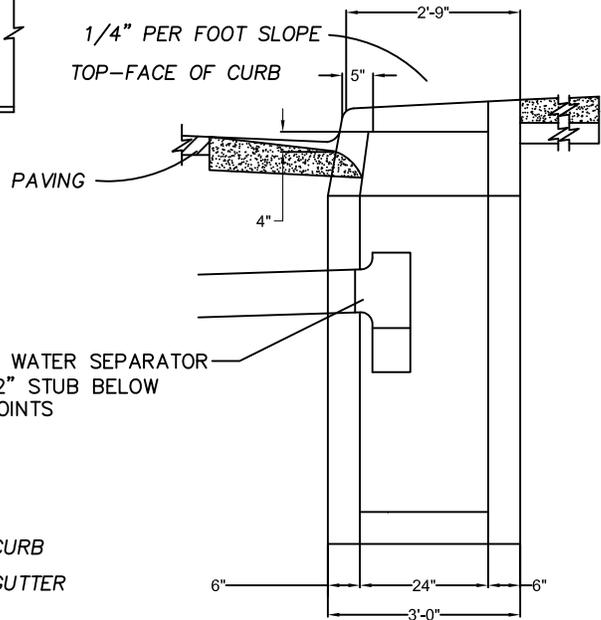

SECTION A-A

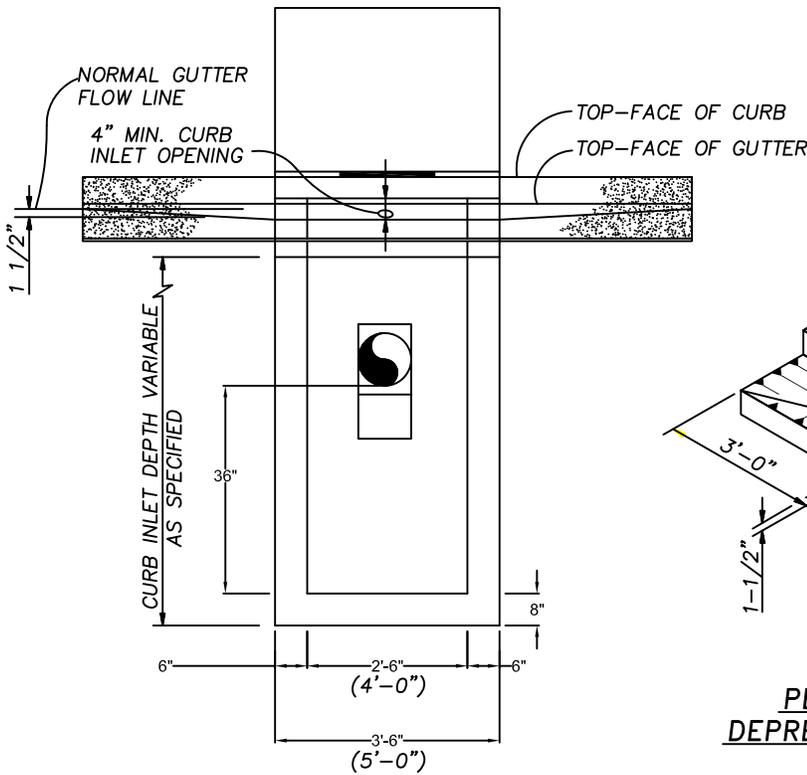

FRONT VIEW

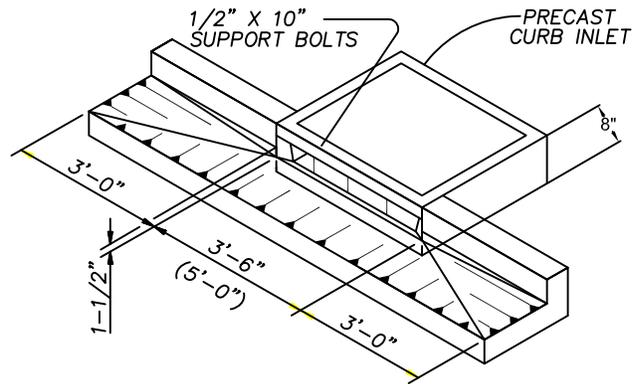

PERSPECTIVE VIEW SHOWING DEPRESSED GUTTER AT CURB INLET

NOTES:

1. CURB INLET TOP AND BASE SHALL MEET H2O LOADING.
2. CURB INLET BASE MAY BE PRECAST OR CAST-IN-PLACE.
3. FOR STEEP GRADES USE STD. PRECAST INLET WITH 4'-0" OPENING OR TWO 2'-6" OPENING INLETS.
4. CONCRETE STRENGTH SHALL BE 3000 PSI.
5. ALL FABRICATED METAL PARTS SHALL BE HOT-DIPPED GALVANIZED AFTER FABRICATION.
6. DIMENSIONS SHOWN ABOVE IN PARENTHESES ARE FOR 4A INLETS.
7. A 1 1/2 A INLET SHALL HAVE A CURB INLET OPENING WIDTH OF 1'6" AND AN OUTSIDE WIDTH OF 2'6"; ALL OTHER DIMENSIONS AND DETAILS SHALL BE AS SHOWN.

**CITY OF FLORENCE
STANDARD DRAWING**

**PRECAST CURB
INLET 1-1/2A,
2-1/2A
4A**

DATE:
12-2011

DRAWING NO.
F-304