

EXHIBIT G




KCL
ENGINEERING
312 NW 10th Ave
Suite 100
Portland, OR
97209

LIGHTING FIXTURE SCHEDULE - SITE PLAN

TYPE	MANUFACTURER	MODEL	DESCRIPTION	VOLTAGE	LOAD-VA	LAMP TYPE
S1	LITHONIA	DSX0 LED-P4-30K-T5W-MVOLT	EXTERIOR POLE MOUNTED FIXTURE, TYPE 5W LIGHT DISTRIBUTION, 15' POLE HEIGHT, DARK SKY COMPLIANT.	120 V	92 VA	LED, 3000K
S2	LITHONIA	DSX0 LED-P4-30K-T3M-MVOLT	SIMILAR TO TYPE S1, TYPE 3M LIGHT DISTRIBUTION	120 V	92 VA	LED, 3000K
S3	LITHONIA	DSX0 LED-P4-30K-T4M-MVOLT	SIMILAR TO TYPE S1, TYPE 4M LIGHT DISTRIBUTION.	120 V	92 VA	LED, 3000K
S4	LITHONIA	RADB-LED-P4-30K-SYM-DBLXD	3' BOLLARD LIGHT FIXTURE, DARK SKY COMPLIANT.	120 V	19 VA	LED, 3000K
S5	LITHONIA	ARC2-LED-P3-30K	EXTERIOR WALLPACK, 3000 LUMENS, MOUNTED +12'-0", DARK SKY COMPLIANT.	120 V	24 VA	LED, 3000K

Calculation Summary

Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
FABRIC_Planar	Illuminance	FC	1.30	4.46	0.3	14.87	14.87
Perimeter1	Illuminance	FC	0.25	4.6	0.0	N/A	N/A
Perimeter2	Illuminance	FC	0.25	2.4	0.0	N/A	N/A

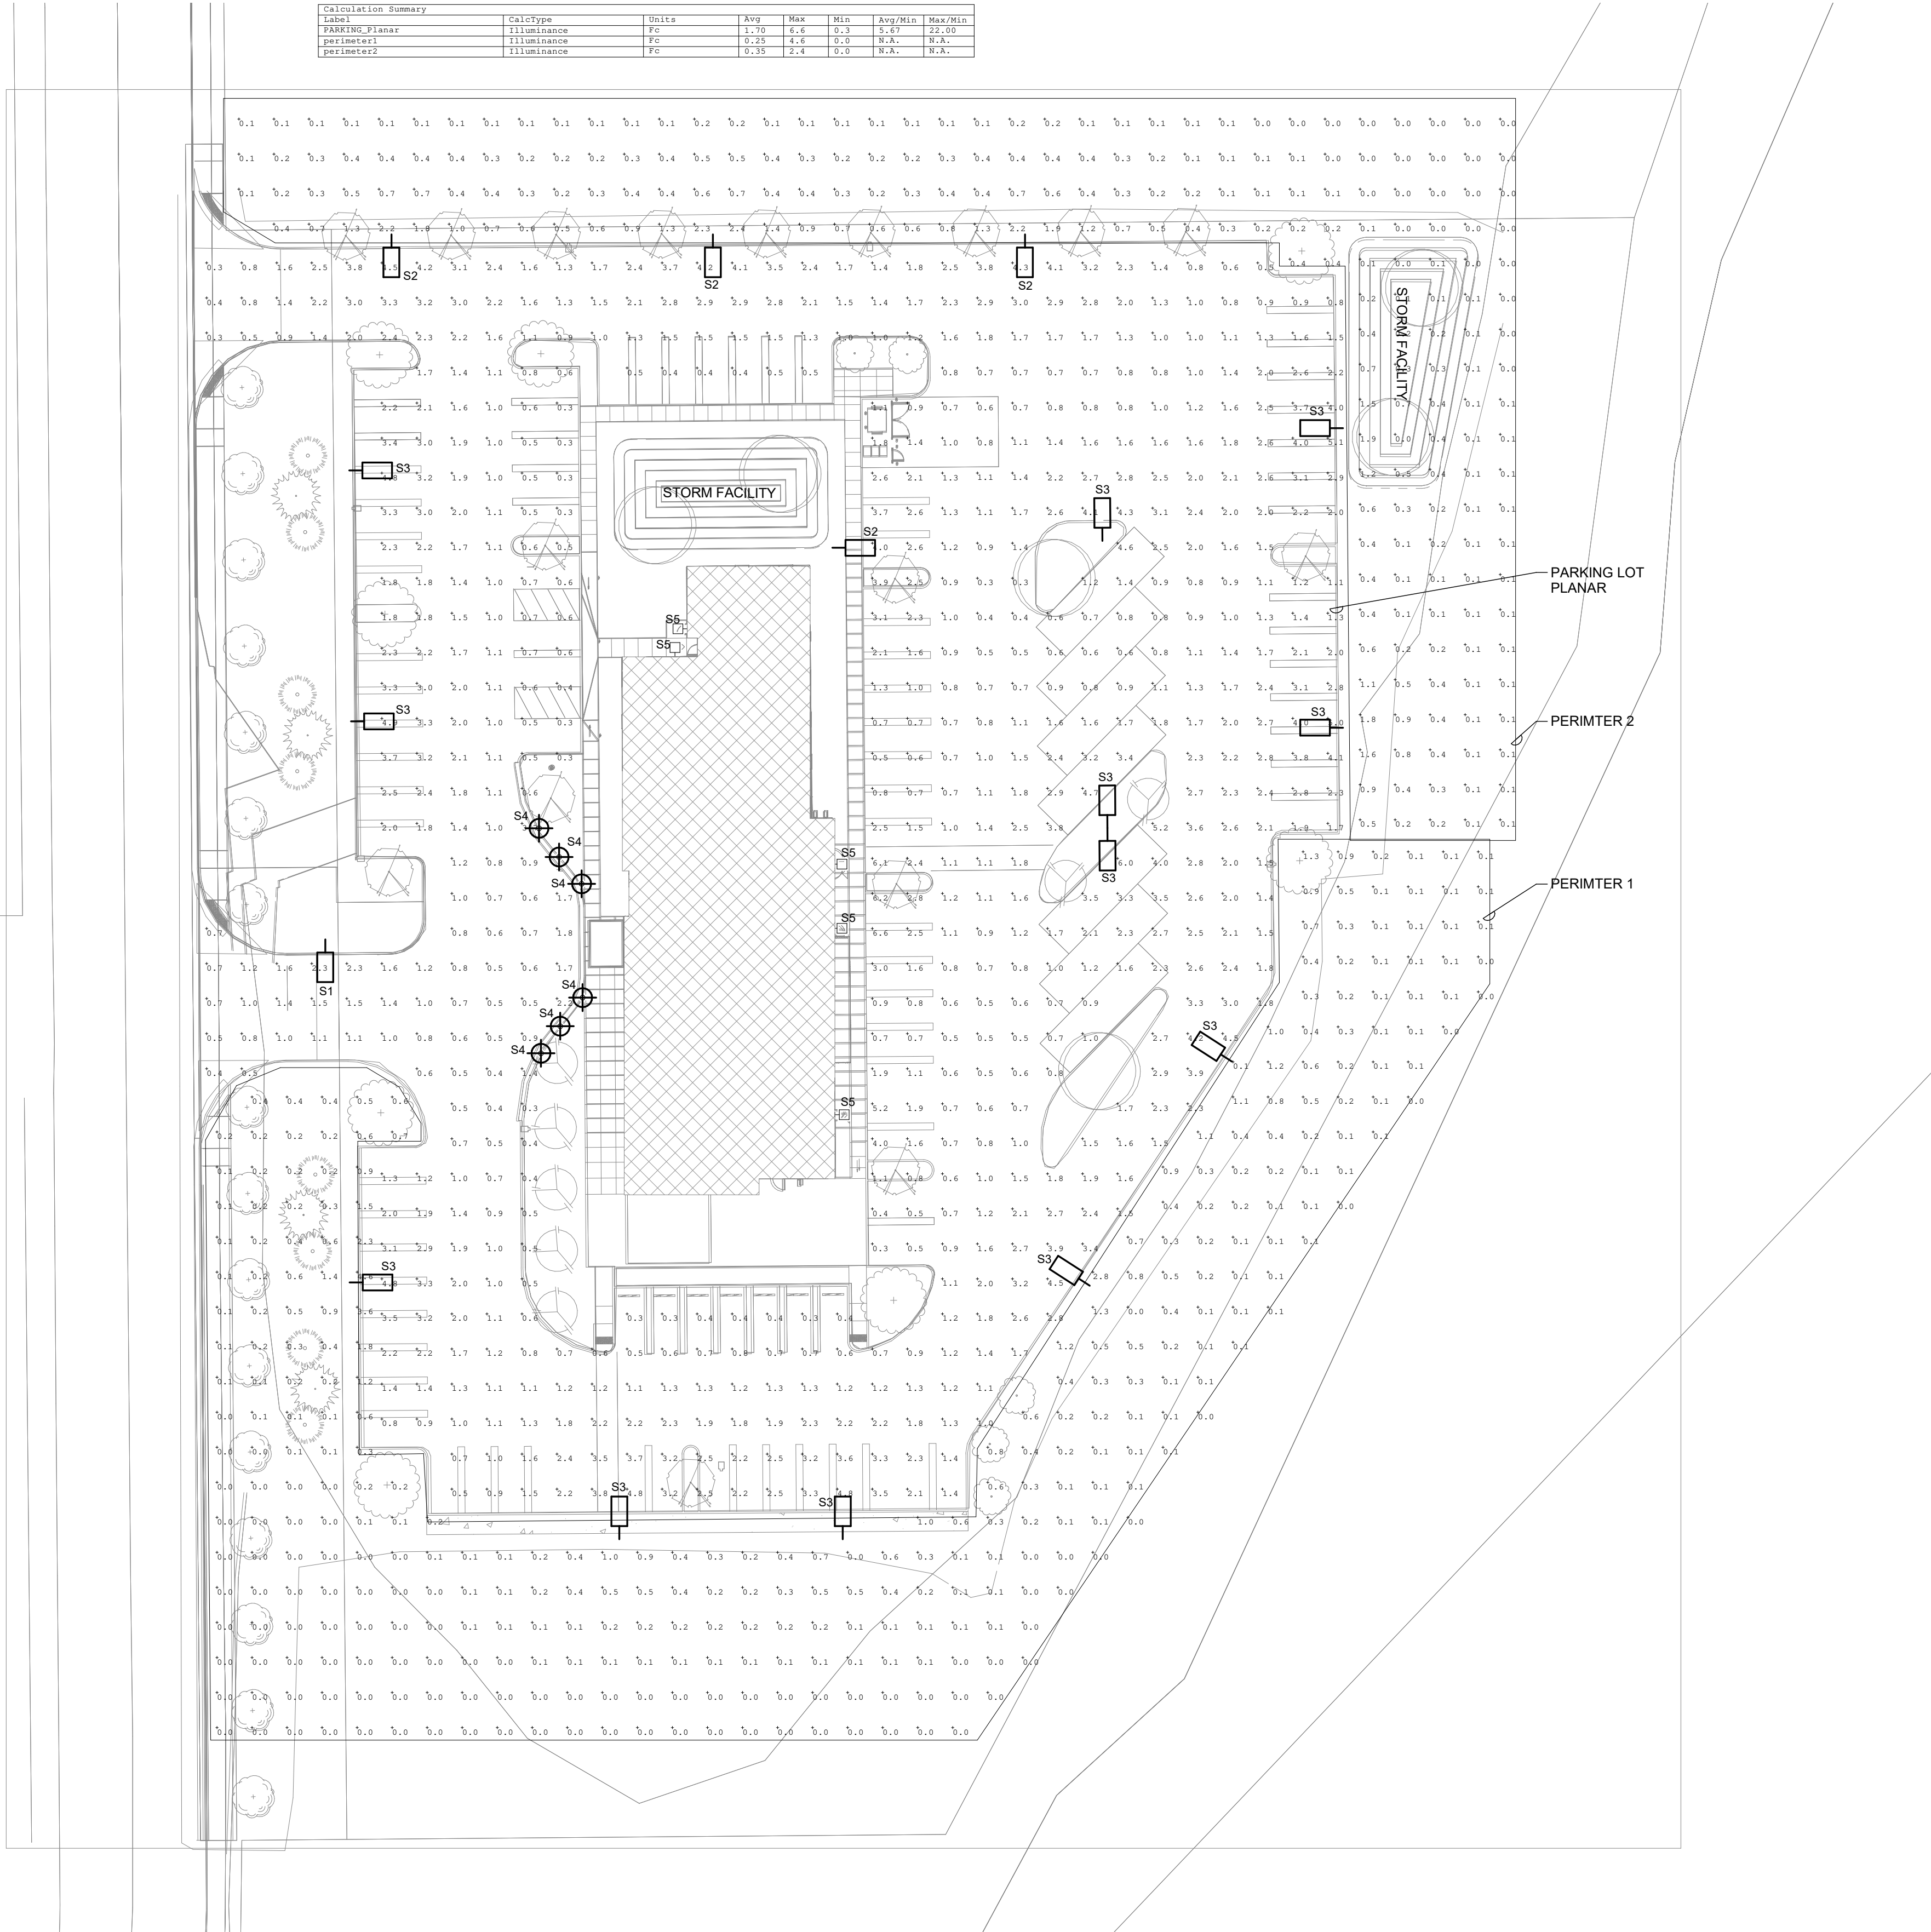

2/18/2022 2:12:51 PM F:\KCL\Projects\21203 - Microtel by Wyndham Florence OR\Design Data\Electr\Lighting\Microtel Photometric Plan.rvt

1 SITE LIGHTING PHOTOMETRIC PLAN
1" = 30'-0"

NOT FOR CONSTRUCTION

FLORENCE MICROTTEL
FLORENCE, OR

LAND USE APP
2/22/2022



DESCRIPTION DATE

SITE LIGHTING
PHOTOMETRIC PLAN
E001