



JOINTS IN SIDEWALK TO MATCH JOINT IN CURB


**REQUIRED SIDEWALK WIDENING  
AROUND OBSTRUCTIONS**

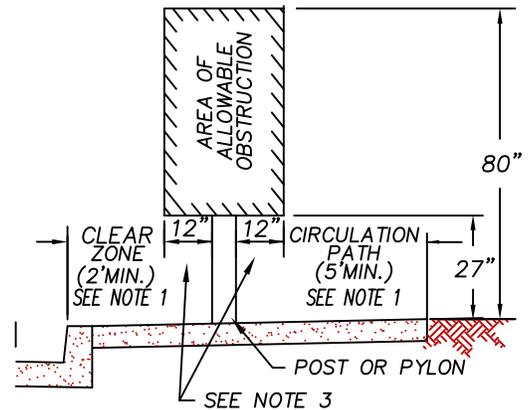

**POST MOUNTED OBSTRUCTION  
WITHIN SIDEWALK**

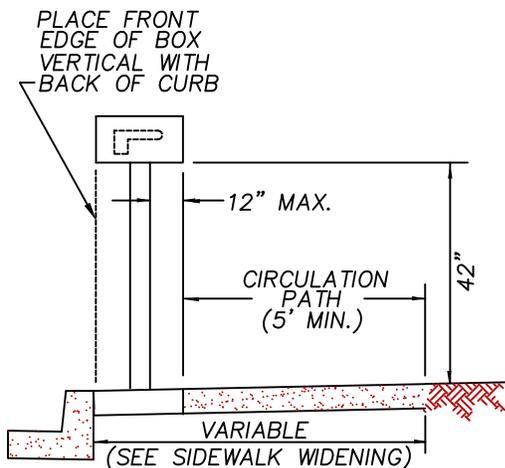

**TYPICAL MAILBOX INSTALLATION**

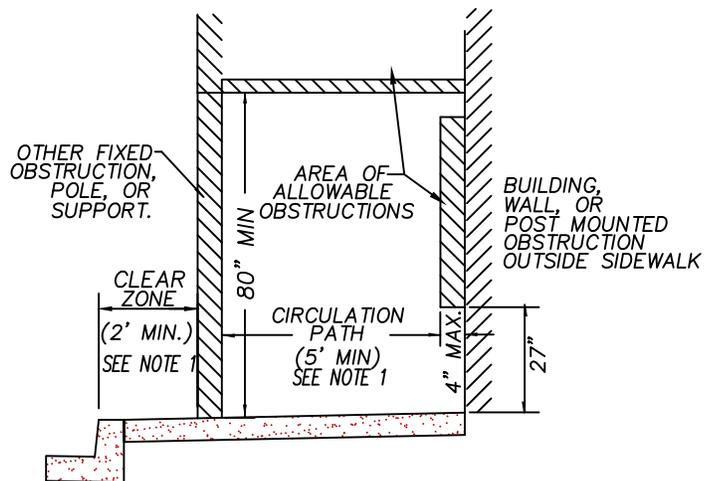

**PROTRUDING OBJECTS  
AND OTHER OBSTRUCTIONS**

**NOTE:**

1. CLEAR ZONE AND THE CIRCULATION PATH MAY BE COMBINED PROVIDING A 5 FOOT MINIMUM SIDEWALK WIDTH IS MAINTAINED.
2. DEFLECT SIDEWALK AROUND AREA OF OBSTRUCTION WHEN OVERHANGS EXCEED ALLOWABLE LIMITS.
3. WHEN OBSTRUCTIONS ARE LOCATED WITHIN THE SIDEWALK AREA THE DIMENSION APPLIES IN ALL DIRECTIONS.
4. INSTALL FULL DEPTH EXPANSION JOINT AROUND ALL OBSTRUCTIONS PENETRATING SIDEWALK SURFACE.
5. ON CUL-DE-SACS, PLACE FRONT EDGE OF MAILBOX 6 INCHES BEHIND BACK OF CURB.
6. EXCEPTIONS TO THE REQUIREMENTS IN THIS DRAWING MUST BE APPROVED BY THE ENGINEER AND MUST COMPLY WITH 'AMERICANS WITH DISABILITY ACT.'
7. CONCRETE STRENGTH SHALL BE 3300 PSI.
8. MAIL BOX SHALL BE LOCATED 25' FROM CURVE RETURN OF INTERSECTION.

**CITY OF FLORENCE  
STANDARD DRAWING**

**SIDEWALK DETAILS:  
OBSTRUCTIONS  
AND  
PROTRUDING OBJECTS**

DATE:  
REV-10-25-12

DRAWING NO.  
F-205a