



PERPENDICULAR CURB RAMPS (TYPE 1)

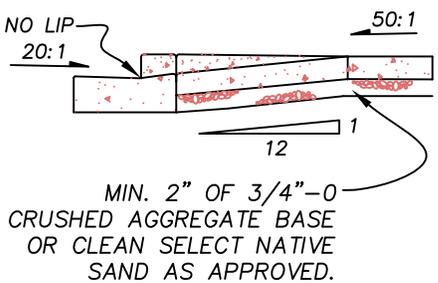

TYPICAL SECTION THROUGH RAMP

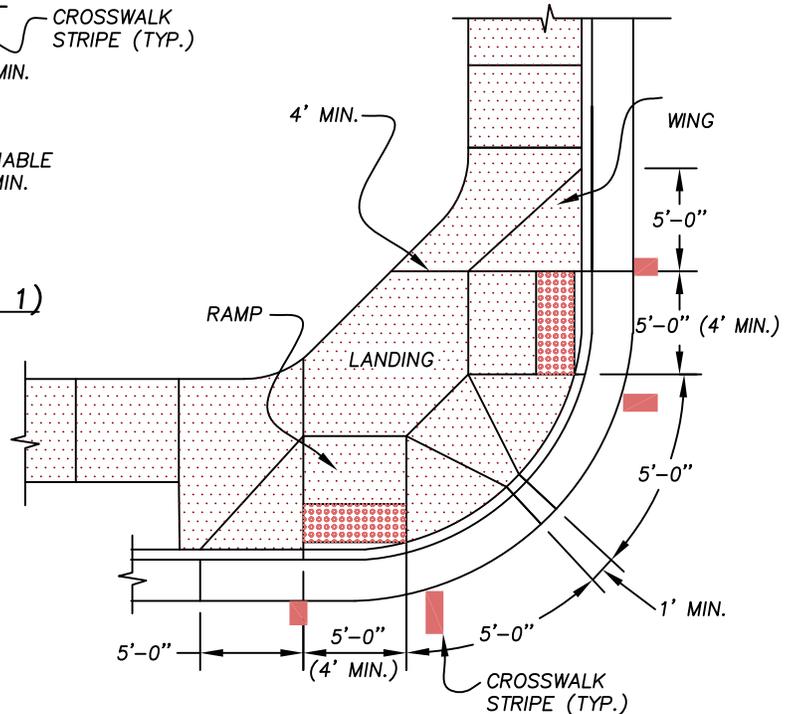

PERPENDICULAR CURB RAMPS (TYPE 2)

NOTES:

1. THE "AMERICANS WITH DISABILITIES ACT" (ADA) REQUIRES THAT ACCESS RAMPS TO SIDEWALKS CONFORM TO ALL FEDERAL GUIDELINES. EXCEPTIONS TO THE REQUIREMENTS IN THIS DRAWING MUST BE APPROVED BY THE ENGINEER AND MUST COMPLY WITH A.D.A.
2. NO ABOVE GROUND UTILITIES ARE PERMITTED WITHIN RAMP AREA.
3. LANDINGS SHALL BE PLACED AT THE TOPS OF RAMPS. LANDING SLOPE SHALL NOT EXCEED 50:1 IN ANY DIRECTION. THE SLOPE OF THE SURFACING AT THE BOTTOM OF THE RAMPS SHALL NOT EXCEED 20:1 FOR A DISTANCE OF 2' (SEE TYPICAL SECTION ABOVE).
4. MINIMUM LANDING DIMENSIONS SHALL BE 4' x 4'.
5. RAMP SURFACE SHALL BE TEXTURED WITH RAISED TRUNCATED DOME TEXTURE. TEXTURING SHALL BE DONE WITH AN EXPANDED METAL GRATE STAMPED INTO THE CONCRETE OR O.D.O.T. YELLOW PLASTIC TRUNCATED DOME.
6. CONCRETE STRENGTH SHALL BE 3300 PSI MIN.

**CITY OF FLORENCE
STANDARD DRAWING**

**SIDEWALK
ACCESS RAMP**

DATE:
MARCH 2007

DRAWING NO.
F-206