



PLAN

NOTES:


1. PRECAST BASE WALLS MAY BE A MINIMUM OF 4" THICK.
2. CONCRETE SHALL BE CLASS 3000.
3. APPROVED CAST IRON FRAMES AND GRATES MAY BE ACCEPTED.

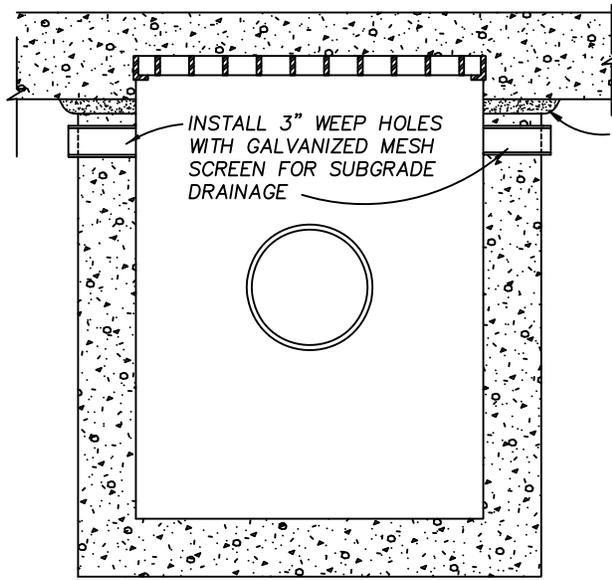

SECTION A-A

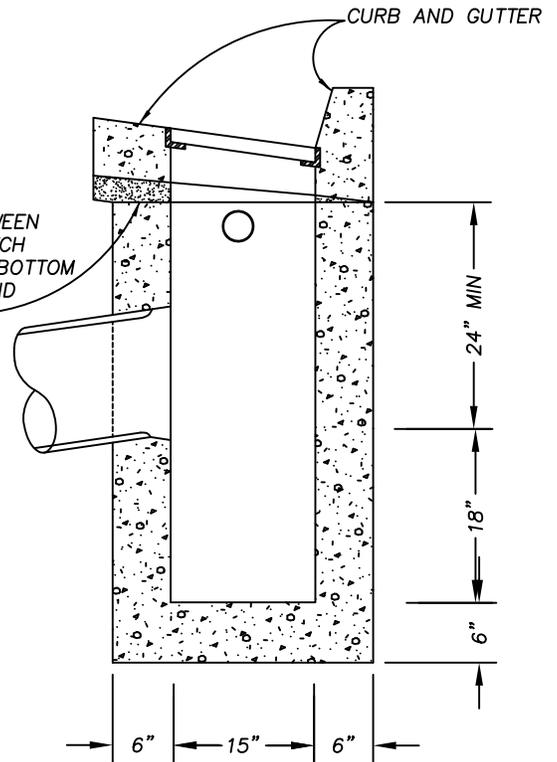


SECTION B-B

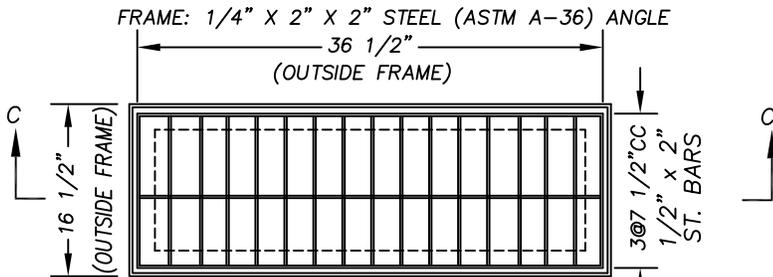

FRAME AND GRATE PLAN

ALL CORNERS OF GRATE BARS TO BE WELDED

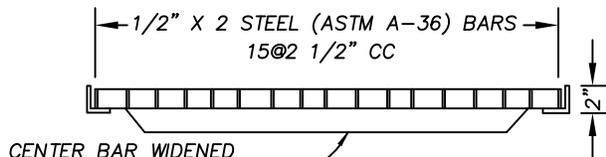

SECTION C-C

**CITY OF FLORENCE
STANDARD DRAWING**

CATCH BASIN

DATE:
MARCH 2007

DRAWING NO.
F-305