



One Spacer Shall Be Placed On The Spigot End of Each Carrier Pipe Segment.  
 Subsequent Spacers Shall Be Spaced at 6' - 8' Intervals for PVC Pipe, or at 8' - 10' Intervals for Ductile Iron Pipe

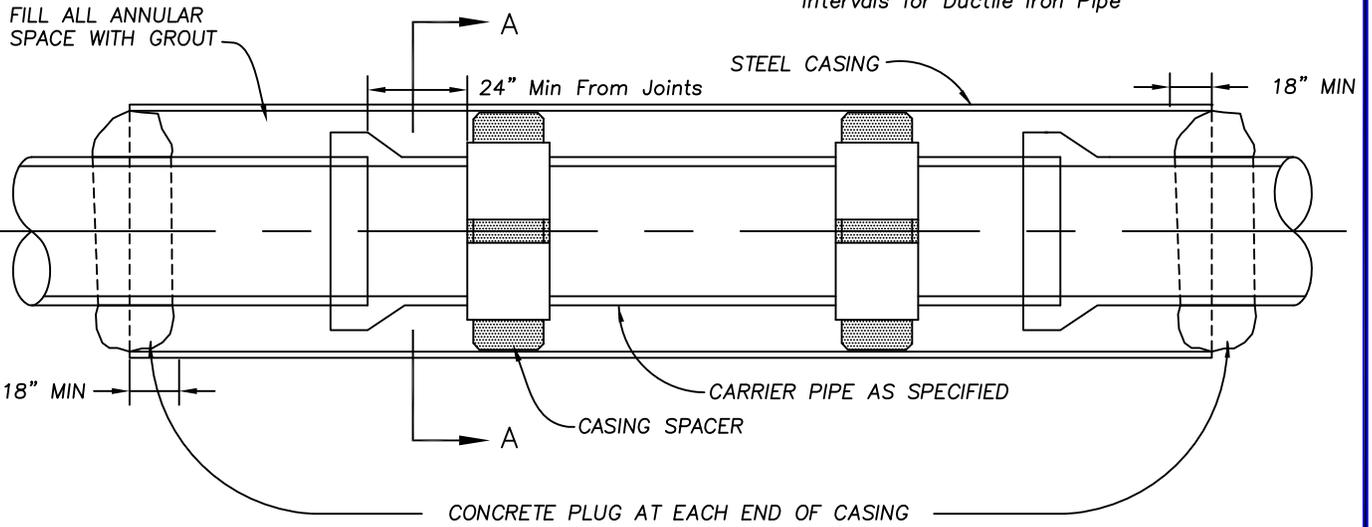

PLAN

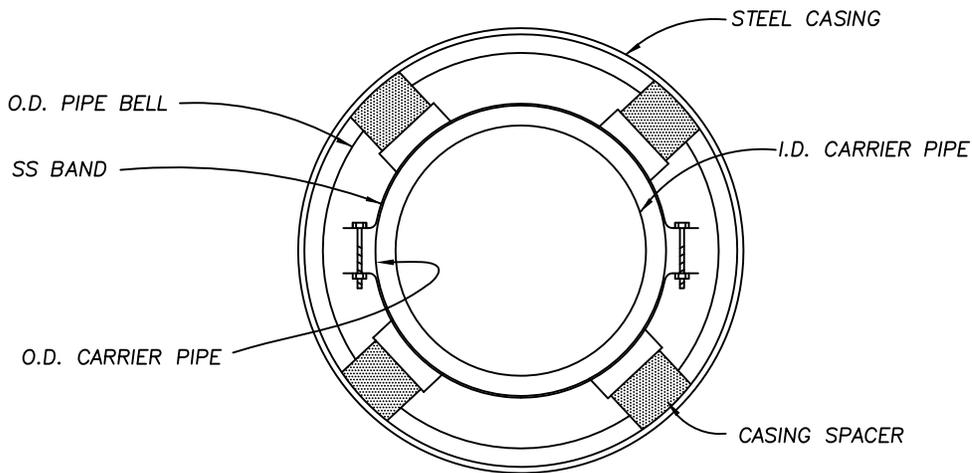

SECTION A-A

NOTES:

1. PLUG ENDS OF CASING WITH CONCRETE.
2. PUMP GROUT SLOWLY WITH MINIMAL PRESSURE TO PREVENT PIPE DEFORMATION.
3. CASING SPACERS BWM COMPANY MODEL BWM SS-8 OR APPROVED EQUAL. ALL HARDWARE SHALL BE 304 STAINLESS STEEL.

**CITY OF FLORENCE  
 STANDARD DRAWING**

**BORE CASING  
 DETAIL**

DATE:  
 JAN-2012

DRAWING NO.  
 F-307A