



COVER PLAN

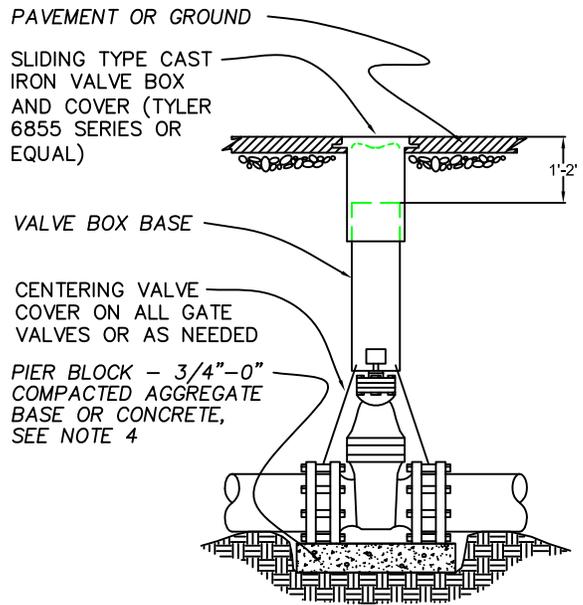

VALVE BOX ASSEMBLY DETAIL

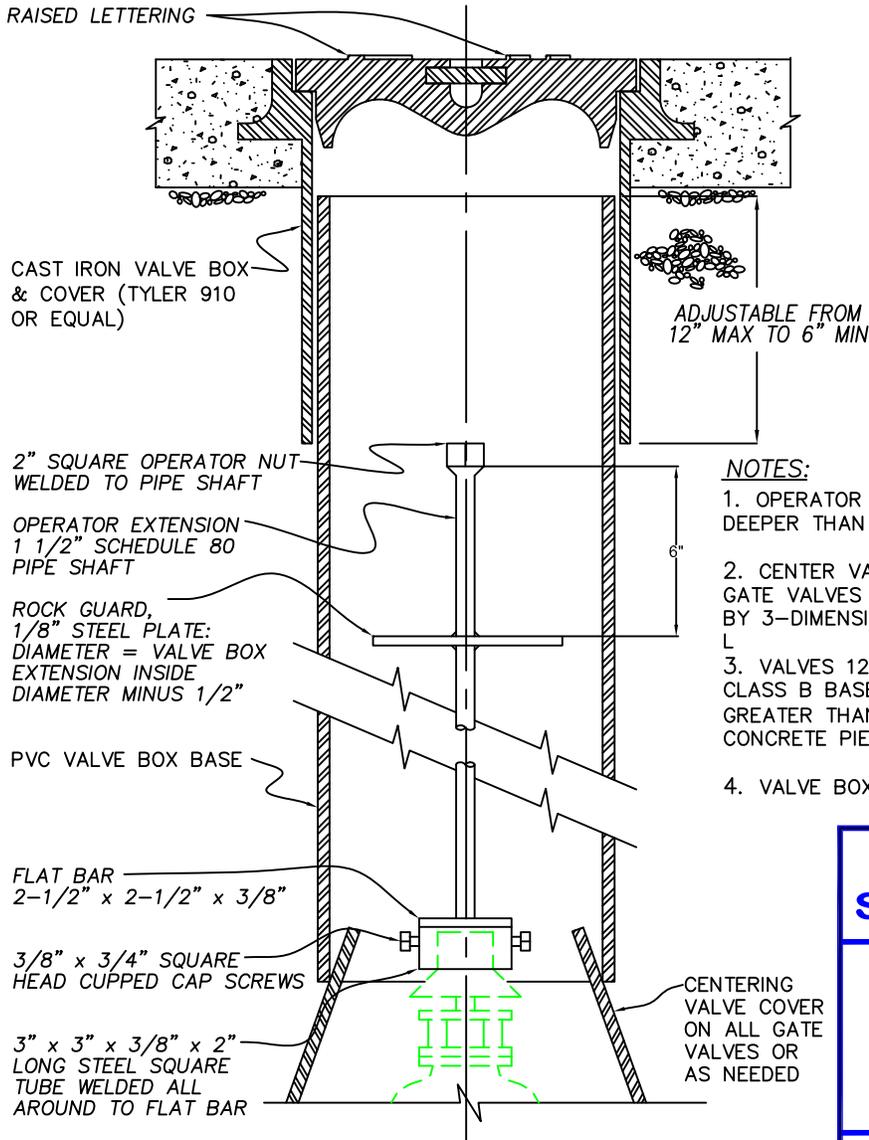

VALVE BOX EXTENSION SECTION

NOTES:

1. OPERATOR EXTENSION REQUIRED WHEN VALVE NUT IS DEEPER THAN 4 FEET FROM FINISH GRADE.
2. CENTER VALVE BOX ON AXIS OF OPERATOR NUT. GATE VALVES REQUIRE VC212 CENTERING VALVE COVER BY 3-DIMENSIONING CONTRACTING OR EQUAL.
3. VALVES 12" AND SMALLER SHALL BE PROVIDED WITH CLASS B BASE ON UNDISTURBED GROUND. VALVES GREATER THAN 12" SHALL BE INSTALLED ON PRECAST CONCRETE PIER BLOCK.
4. VALVE BOX BASE SHALL BE PVC (ASTM D3034).

**CITY OF FLORENCE
STANDARD DRAWING**

**VALVE BOX &
OPERATOR EXTENSION
ASSEMBLY**

DATE:
DEC-2011

DRAWING NO.
F-403