


**Secondary  
Clevis**

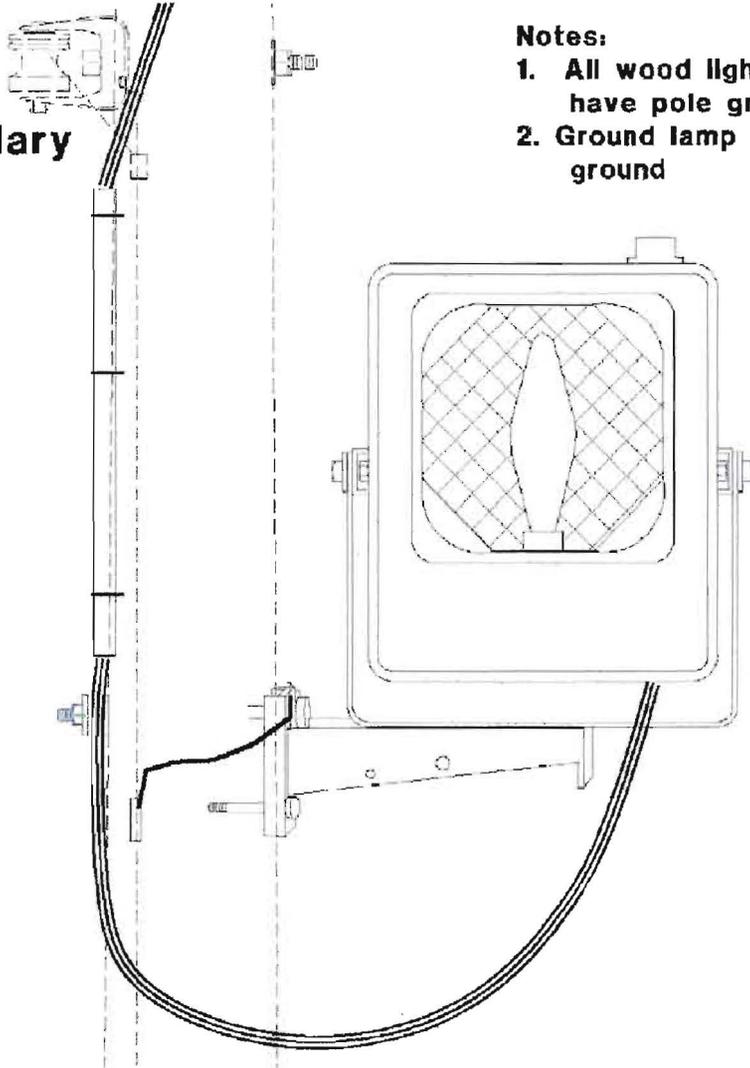

**Notes:**

- 1. All wood lighting poles must have pole ground (86.10)**
- 2. Ground lamp case to pole ground**

**CITY OF FLORENCE  
STANDARD DRAWING**

**CENTRAL LINCOLN PUD  
FLOOD LIGHT  
400w STANDARD  
DETAIL 97.40**

DATE:  
**MARCH 2006**

DRAWING NO.  
**F-514**